

NORTHWEST LABORATORIES *of Seattle, Incorporated*

ESTABLISHED 1896

Technical Services for: Industry, commerce, Legal Profession & Insurance Industry

241 South Holden Street • Seattle, WA 98108-4359 • Phone: (206) 763-6252 • Fax: (206) 763-3949 www.nwllabs1896.com

Report To: Appian Way Sales
Attention: Rusty Sproatt

Date: December 13, 2010

Report On: Perimeter Paver Pedestal Crush Test

Lab No.: E84639

PEDESTAL CONSTRUCTION:

Each pedestal utilizes two (2) 1½" Sch 40 DWV PVC Pipe with pedestal cap and base

TEST METHOD:

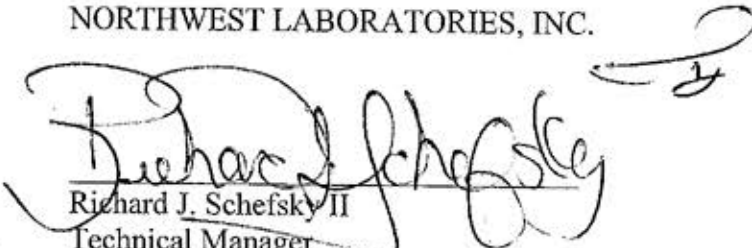
Vertical Compression Test utilizing two (2) 1½" PVC Pipe with cap and base

TEST RESULTS:

<u>Sample Height (in.)</u>	<u>Ultimate Load (lbs.)</u>	<u>Failure Mode</u>
1.5	18,000	PVC Pipe
2.0 A	15,100	PVC Pipe
2.0 B	14,900	PVC Pipe
4.0 A	16,350	PVC Pipe
4.0 B	15,500	PVC Pipe
6.0 A	15,700	PVC Pipe
6.0 B	15,000	PVC Pipe
8.0 A	15,500	PVC Pipe
8.0 B	14,450	PVC Pipe
10.0 A	15,750	PVC Pipe
10.0 B	13,450	PVC Pipe

This report applies only to the actual samples tested. Northwest Laboratories does not certify, warrant, or guarantee any products manufactured by others. Samples discarded within **thirty (30) days** unless otherwise requested in writing by you.

NORTHWEST LABORATORIES, INC.


Richard J. Schefsky II
Technical Manager